


PLAN

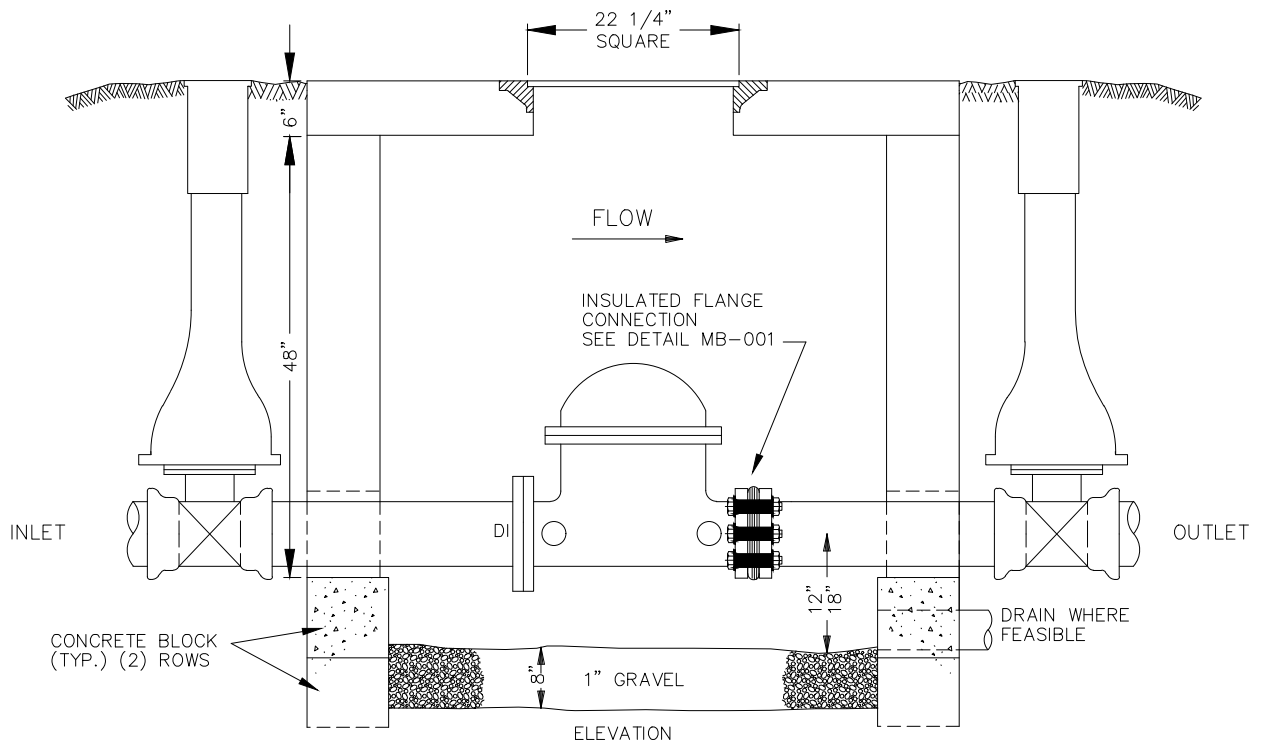

ELEVATION

1. FRAMES OF OPENING TO BE SET IN PLACE, NOT IN CONCRETE
2. STANDARD 48"X 48" INSIDE DIMENSION CONCRETE VAULT WITH OPEN BOTTOM NOTCHED FOR 8" PIPE.
3. CLASS 52 DI PIPE EXTENDED MIN. 6' FROM OUTLET SIDE OF VAULT. (ZINC COATED DI PIPE WITH V-BIO POLYWRAP OPTIONAL IN HIGHLY CORROSIVE SOIL AREAS)
4. BOX TO BE SET WITH TOP OF BOX AT FINISHED GRADE WITH NO EXTENSION ALLOWED.
5. SERVICE MUST BE INSPECTED BEFORE BACKFILL BY AUTHORIZED COMPANY REPRESENTATIVE.
6. (2) ROWS OF CONCRETE BLOCKS, ANY ADDITIONS MUST BE APPROVED BY AN AUTHORIZED COMPANY REPRESENTATIVE.
7. NO MEGALUG OR UNIFLANGE TYPE JOINTS ALLOWED IN VAULT.

DRG. #DCV-468FS

SUBJECT TO REVISION WITHOUT NOTICE 08-28-2020

DETECTOR CHECK VAULT FOR 4",6",8" FIRE SERVICES